


Thermal bridge calculation for the window frame and installation of Ecocontract ULTRA All Timber opening window as a Non-Certified Passive House Component

for
Green Building Store
Heath House Mill, Heath House Lane, Golcar
Huddersfield HD7 4JW UK

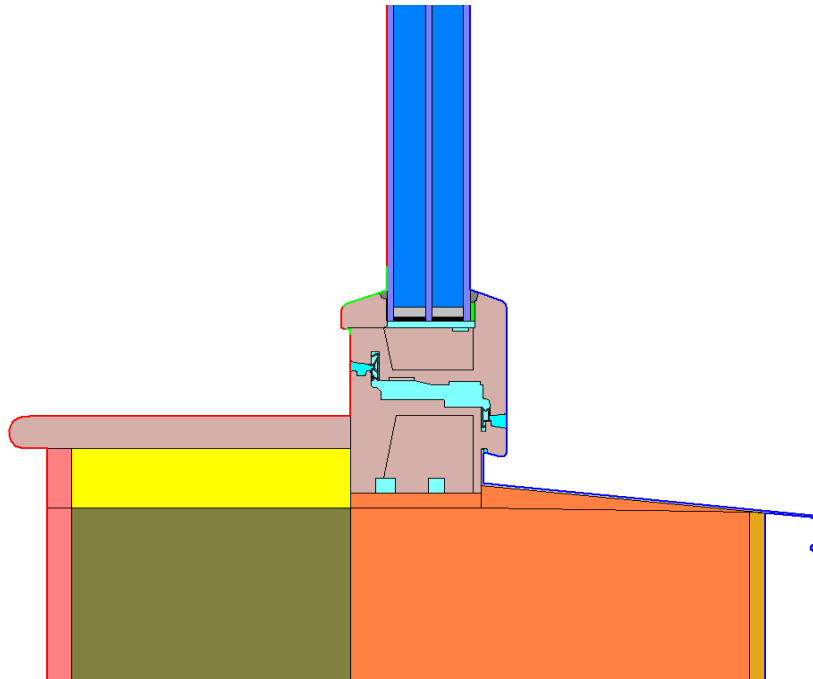

WARM: Low Energy Building Practice

3 Admirals Hard
PLYMOUTH, UK PL1 3RJ
Phone: +44 (0) 1752 542 546

Window Report V123

November 2013

© WARM 2013, based on PHI template

Office@peterwarm.co.uk

Author: peter warm, checked: PW

Thermal Performance Report for Ecocontract ULTRA All Timber opening window 1
for the Green Building Store Company, Huddersfield UK

This report is provided for the stated purposes and for the sole use of the named client. Warm accepts responsibility to the client alone that the report has been prepared by a competent engineer but accepts no responsibility to any parties other than the client.

Summary

The Ecocontract ULTRA All Timber opening window from the Green Building Store company has been analysed and this report contains the data needed to use this window in PHPP for the design of a Passivhaus, including various installation situations.

The enclosed table of values (Section 9) has been designed to cut and paste directly into PHPP, to quickly enable designers to accurately model one of these windows.

This window does not meet the certification criteria for a Passivhaus certified window. However, provided it is used in suitable locations where the external design temperature is above -13 C, then it will pass the comfort part of the certification criteria (-16 C being the certification level).

This window passes the hygiene requirements for a Passivhaus certified window.

The choice of the Swisspacer Ultimate spacer is an important part of reaching the criteria.

In conclusion, this window can be successfully used as part of Passivhaus design provided attention is paid to its use in a suitable climate. To the author's knowledge, suitable local locations would be England, Wales and Eire; care should be taken in colder areas such as Scotland.

During the construction care should be taken that the windows are installed as stated in the report, otherwise the thermal bridge heat loss coefficient for the installation may be considerably worse. Significantly different situations will require remodelling.

Table of contents

1. Introduction to Passivhaus window analysis	4
2. Guidelines for thermal bridge calculation for windows	5
2.1 Description of the window frame	5
2.2 Glass, Panel and Spacer	5
2.3 Boundary conditions	6
2.4 Used materials and thermal conductivities	6
3. Results of the heat-flow-calculation	8
4. Overview of calculation results	9
5. Window construction	10
5.1 Mullion	11
6. Window U-values for different window sizes	12
7. Installation	12
7.1 Cavity wall	13
7.2 Timber frame	14
7.3 Externally insulated wall	15
8. Alternative glasses offered by manufacturer	16
9. PHPP values	17
10. Appendix: Construction drawings - (not to scale)	18-23
11. Thermal Conductivity Reports	24 -

1. Introduction to Passivhaus window analysis

Because a separate heating system is not necessarily required in Passive Houses, high demands are placed on the quality of the building components used. If no radiator under the windows is planned, the thermal transmittance U_w (U-value) of the window used may not exceed $0.80 \text{ W/(m}^2\text{K)}$, in order to prevent unpleasant radiant heat deprivation and cold air descent at the window. For a given quality of glazing, this results in restriction of the thermal bridge loss coefficient for window frames.

The following requirements for the certificate "Certified Passive House Component - window frame" have been set by the PHI:

$$U_w \leq 0.80 \text{ W/(m}^2\text{K)}$$

U_w is the average thermal transmittance for the whole window. The criterion must be met with $U_g = 0.70 \text{ W/(m}^2\text{K)}$ and with a window size of $1.23 \text{ m} \times 1.48 \text{ m}$.

$$U_{w,\text{installed}} \leq 0.85 \text{ W/(m}^2\text{K)}$$

$U_{w,\text{installed}}$ is the U-value of the installed window. The criterion must be met in a minimum of three installation situations using the same sized frame as above.

Also, the hygiene criterion must be met. For reasons of hygiene, this criterion limits the minimum individual temperature on window surfaces to prevent mould growth. The criterion for a cool, temperate climate is:

$$f_{\text{Rsi}, 0.25 \text{ m}^2\text{K/W}} \geq 0.70$$

At -5°C ambient temperature, 20°C interior temperature and 50% relative humidity the minimum temperature of the surface is limited to 12.6°C .

In addition, certified windows will be ranked by the thermal losses through the opaque parts, represented by Ψ_{opaque} . These efficiency classes include the U-value of the frame, the frame width, the Ψ -value of the glass edge and the length of the glass edge.

The energy balance of Passivhauses, the sum of losses and gains, is very important. Because the solar gains are difficult to quote it is useful to rate the parts of the window that do not allow solar gains. This is done by calculating Ψ_{opaque} .

Table 1: Passive house efficiency classes

Ψ_{opaque}	Passive house efficiency class	Name
$\leq 0.110 \text{ W/(mK)}$	ph A	Advanced component
$\leq 0.155 \text{ W/(mK)}$	ph B	Basic component
$\leq 0.220 \text{ W/(mK)}$	ph C	Certifiable component

2. Guidelines for thermal bridge calculation for windows

On behalf of the Green Building Store company in Huddersfield, WARM has calculated the thermal characteristics for a window based on the regulation EN ISO 10077 (standard size 1.23 m x 1.48 m), with the Ecocontract ULTRA All Timber window frame.

The calculations were carried out using the heat flow software THERM V6.3.46.0 by the American Lawrence Berkley National Laboratory.

2.1 Description of the window frame

The frame is constructed with laminated softwood.

2.2 Glass, Panel and Spacer

For triple glazing with low-e coating, generally a glass U-value of $U_g = 0.7 \text{ W/(m}^2\text{K)}$ is assumed for the calculations in the course of certification. In order to meet the certification criterion $U_w = 0.80 \text{ W/(m}^2\text{K)}$, a frame (including spacer and edge bond) with the corresponding thermal quality is necessary

Table 2: Properties of the glazing and the panel.

Properties of the glazing	Edge-bond	Swisspacer Ultimate
	Number of panes	3
	Thickness of the panes	4/4/4 mm
	Thickness of the gas gap	20 / 20 mm
	Glazing unit	52 mm
	Conductivity of gas gap	0.0321 W/(mK)
	Additional air gap	- mm
	Thickness of additional pane	- mm
	Conductivity of air gap	- W/(mK)
	Thickness of the total glazing	52 mm
	U-Value of the glazing	0.700 W/(m ² K)
Properties of the panel	Conductivity of the panel	0.035 W/(mK)
	U-value of the panel	0.673 W/(m ² K)

In many edge bond constructions, very thin (about 0.025 to 0.1 mm) films are incorporated, the materials of which have a high thermal conductivity. The true-scale representation of the spacer in the calculation model could only be resolved with a very large numerical effort.

Instead of a high resolution representation of the Swisspacer Ultimate spacer, a simplified, but thermally equivalent, replacement was used. This allows a simpler mesh in the calculation model and therefore a viable computational effort.

2.3 Boundary conditions

The boundary conditions for the calculations were chosen to reflect the actual circumstances, i.e. with an external temperature of -10°C , an interior temperature of $+20^{\circ}\text{C}$ and the corresponding heat transfer coefficient at the surfaces (see table below). A reduced inner heat transfer coefficient of $R_{s_i} = 0.20 \text{ (m}^2\text{K/W)}$ was assumed at the inner surfaces of the window corners, in accordance with BS EN 10077-2.

Table 3: Heat transfer resistances and surface temperatures.

Surface	Temperature θ [$^{\circ}\text{C}$]	Heat-transfer resistance R_{s_i} [$\text{m}^2\text{K/W}$]
to ambient	-10	0.04
to ambient with air gap		0.13
to interior	20	0.13
to interior in edges		0.20
to ambient for calculation of $f_{R_{s_i}}$	-5	0.04
to interior for calculation of $f_{R_{s_i}}$	20	0.25

2.4 Used materials and thermal conductivities

In the following table the materials used in the calculation are listed with their thermal conductivities. The thermal conductivities are based on information provided by the company or on established standards. The equivalent thermal conductivity of hollow spaces was determined in accordance with BS EN 10077-2.

Table 4: Thermal conductivities representing the materials used for the calculation model and their colours as they appear in the THERM model diagrams

Window Frame

Name	Conductivity W/m-K	Emissivity
CEN Polysulphide	0.400	0.9
AA SPR Swisspacer Ultimate	0.140	0.9
CEN Glass	1.000	0.9
CEN PH Glazing	0.0321	0.9
CEN EPDM	0.250	0.9
AA TIM General Timber	0.130	0.9
AA INS k034 Elastomeric Foam	0.050	0.9
CEN Silicone Pure 0k35	0.350	0.9
AA Steel Plate in central cavity	50.0	0.9

The elastomeric foam is an unusual material - see appendices
The following materials were used in the installation of the walls

Cavity Wall

AA MAS Concrete Block Heavyweight	1.600	0.90
AA INS k0.037	0.032	0.90
Stone	1.500	0.90
AA FIN Plaster	0.250	0.90
AA MAS Reinforced Concrete	2.100	0.90

Timber Frame

AA FIN Plasterboard & Skim	0.210	0.90
AA TIM General Timber	0.130	0.90
AA TIM Plywood Osb heat flow along ρ	0.208	0.90
AA INS k022	0.022	0.90
AA INS k040	0.040	0.90
AA INS k039 Gutex	0.039	0.90
AA MAS Render	0.700	0.90
CEN Service Void	Calculated	0.90

Externally Insulated Wall

AA MAS Med Conc Block High Cond	0.850	0.90
AA INS k037	0.037	0.90
AA MAS Render	0.700	0.90
AA FIN Plaster	0.250	0.90

3. Results of the heat-flow-calculation

The heat flow rate L_{2D} was calculated for each sectional drawing following BS EN 10077–1 and 2 using the two-dimensional heat flow software programme THERM. For each section, two calculations were carried out, one with the installed glazing and one with a calibration panel (lambda-value of 0.035 W/(m²K)) in place of the glazing. The depth of the edge and thickness of the calibration panel correspond with those of the glazing. Each of the calculated L_{2D} values in W/mK are documented with the respective dimensions of the sections in Table 5. These intermediate results form the basis for the calculation of the U-values and the Ψ -values.

The height of the calculation models is 0.4 m in models with one glazed part and 0.6 m in models with two glazed parts(eg mullion). For installation situations at least 1m or 3 times the wall thickness is added to typically produce 1.4m.

Table 5: Results of the heat flow calculations for all sections [W/mK].

Name			Ecocontract ULTRA All Timber opening window				
Frame with panel	Cill		0.3097				
	Head		0.2948				
	Jamb		0.2948				
	Mullion		0.4209				
Edge bond							
Frame with glass	Cill		0.3564				
	Head		0.3440				
	Jamb		0.3440				
	Mullion		0.5097				
Cavity wall	Cill		0.4746				
	Head		0.5425				
	Jamb		0.5425				
Timber frame	Cill		0.4824				
	Head		0.4535				
	Jamb		0.4535				
Externally insulated wall	Cill		0.5068				
	Head		0.4879				
	Jamb		0.4879				

4. Overview of calculation results


Table 6: Overview of calculation results.

Name		Passivhaus Transparent Component Certification Criteria	Ecocontract ULTRA All Timber opening window				
frame width b_f [m]	Cill		0.138				
	Head		0.120				
	Jamb		0.120				
	Mullion		0.136				
U-value of the frame U_f [W/(m ² K)]	Cill		1.098				
	Head		1.048				
	Jamb		1.048				
	Mullion		1.036				
Edge bond							
th. bridge of edge bond ψ_g [W/(mK)]	Cill		0.0215				
	Head		0.0223				
	Jamb		0.0223				
	Mullion		0.0221				
Minimum Internal Temps [C]	Cill		13.30				
	Head		13.30				
	Jamb		13.30				
	Mullion		13.40				
Lowest Min Int Temp [C]		12.6	13.3				
Frsi based on -5 C		0.70	0.73				
Hygiene satisfied above ext. temp of:		-5	-8				
Window-U-value U_w [W/(m²K)]		0.80	0.87				
Comfort satisfied above ext. temp of:		-16	-13				
Ψ_{opaque} [W/(mK)]			0.143				
Passive House Efficiency class			phB				
Thermal installation bridge $\Psi_{install}$ [W/(mK)] und $U_{W,installed}$ [W/(m²K)]							
Cavity wall	Cill		-0.0023				
	Head		-0.0041				
	Jamb		-0.0041				
	$U_{W,installed}$	0.85	0.863				
Timber frame	Cill		-0.0019				
	Head		-0.0186				
	Jamb		-0.0031				
	$U_{W,installed}$	0.85	0.855				
Externally insulated wall	Cill		0.0192				
	Head		0.0051				
	Jamb		0.0051				
	$U_{W,installed}$	0.85	0.899				

5. Window construction

In the following figures, the colour coded construction is shown on the left, with the heat flux results in the middle, and the isothermal results on the right.

Figure 1 shows the sections 'head/jamb' and 'cill' of the window with 52 mm wide glazing and the Swisspacer Ultimate spacer.

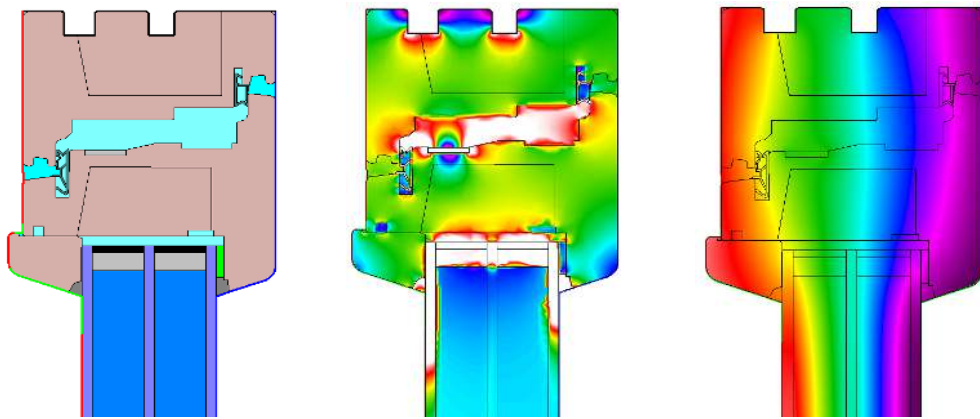

Warm Inside (20°C)

Cold Outside (-10°C)



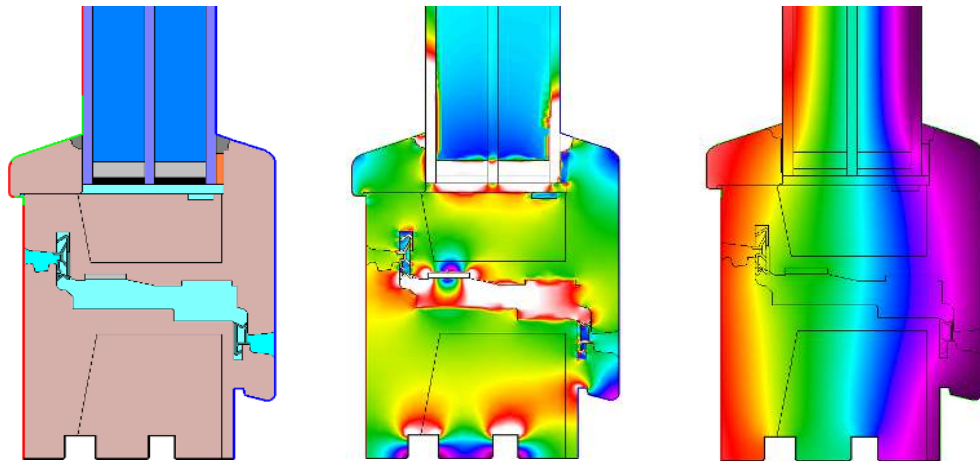


Figure 1: : Section 'head/jamb' and 'cill' with the respective heat flux and isothermal graphics.

5.1 Mullion

Figure 2 shows the section of a Mullion of the assessed window system with 52 mm wide glazing and the Swisspacer Ultimate spacer.

The thermal properties of this section are given for information only. They are not part of the calculation of the window U-value. However, they can be used to determine the correct PHPP data for windows with mullions.

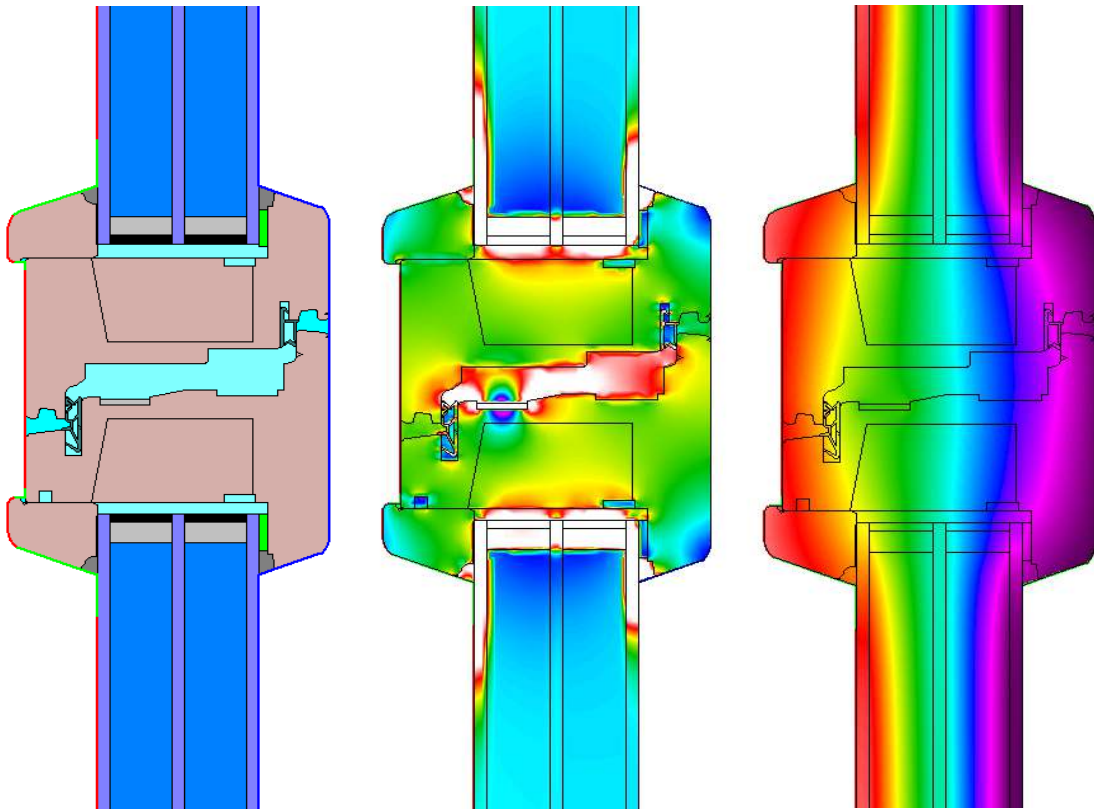


Figure 2: Section of the Mullion of the window system with respective isothermal and heat flux graphics.

6. Window U-values for different window sizes

The U-value U_W of an uninstalled window of any size can be determined using the following equation:

$$U_W = \frac{A_g \cdot U_g + A_f \cdot U_f + l_g \cdot \Psi_g}{A_g + A_f}$$

where: A_g Glazing area [m²] U_g Average glazing U-value [W/(m²K)]
 A_f Frame area [m²] U_f Average frame U-value [W/(m²K)]
 l_g Length of sight line [m] Ψ_g Av. th. bridge of sight line [W/(mK)]

The sight line is the perimeter of the visible glazing

7. Installation

Besides the heat transfer through window frames and glazing, the connection of the frame to a suitable Passivhaus wall construction is of considerable importance for the whole system (the U-value of the wall must be less than 0.15 W/(m²K)). Therefore, three typical installation situations (the specific arrangement of which were given by the manufacturer) were tested for their suitability.

The results are shown in table 5 and 6. For the calculation models and the respective isothermal graphics, see the following pages.

The U-value of an installed window of any size can be determined using the following equation:

$$U_{W,installed} = \frac{A_W \cdot U_W + l_{instal.} \cdot \Psi_{instal.}}{A_W}$$

where: A_W Window area [m²] U_W Window-U-value [W/(m²K)]
 $l_{instal.}$ Length of installation [m] $\Psi_{instal.}$ Av. th. installation bridge [W/(mK)]

7.1 Cavity wall

The following figure shows the installation of the Ecocontract ULTRA All Timber 'side/top' and 'bottom' in a Cavity wall.

In the following figures, the heat flux results are shown on the left, with the respective isothermal results shown on the right. The construction details are in the appendices.

In order to better represent the details, only relevant sections of the calculation model are shown.

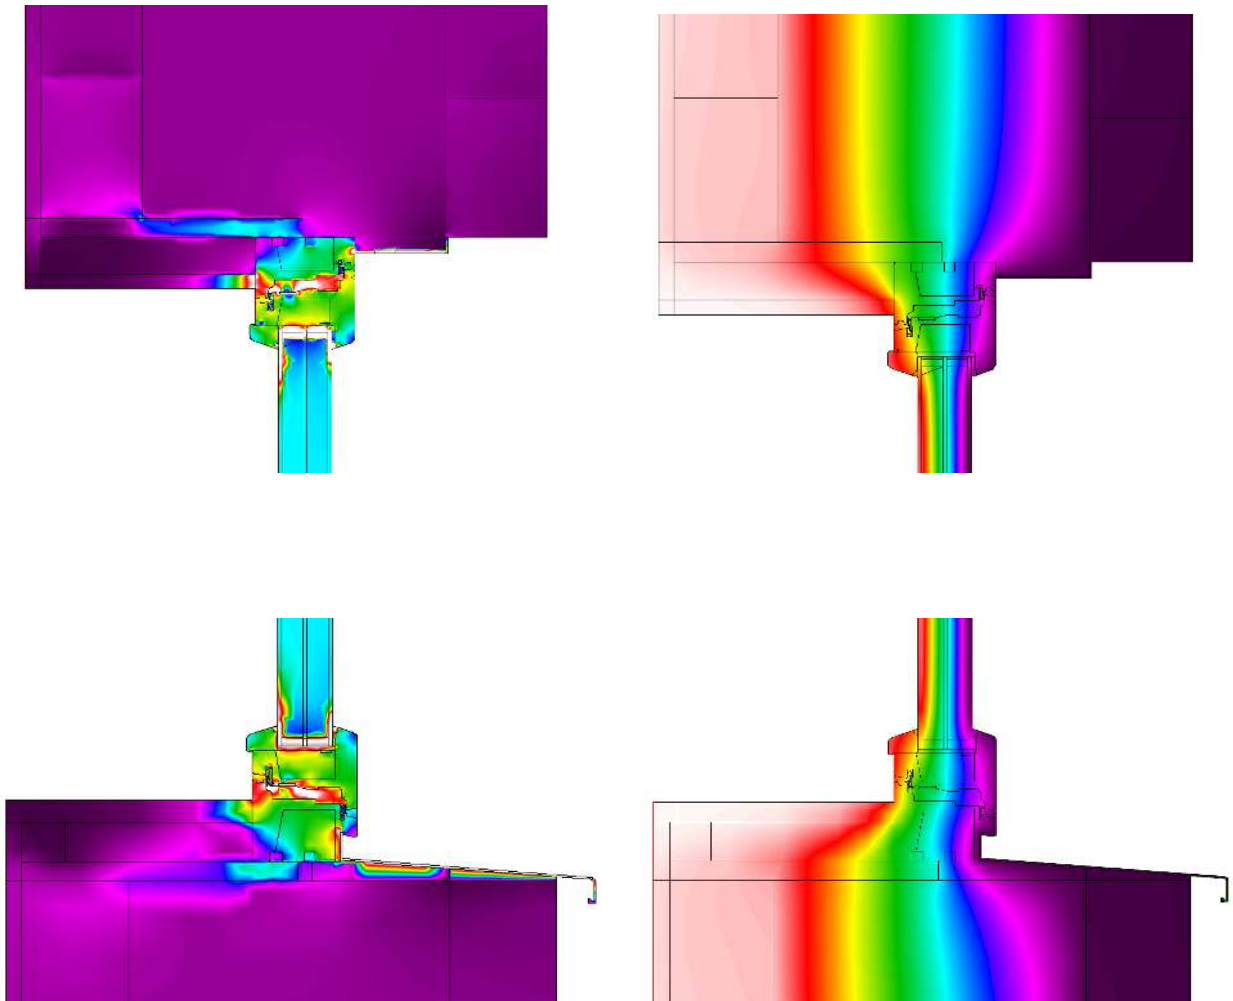


Figure 3: Installation head/jamb and cill in a Cavity wall with respective isothermal graphics

	U wall [W/(m ² K)]	$\Psi_{\text{instal., bottom}}$ [W/(mK)]	$\Psi_{\text{instal., s./top}}$ [W/(mK)]	$U_{W,\text{installed}}$ [W/(m ² K)]
	0.118	-0.002	-0.004	0.86

7.2 Timber frame

The following figure shows the installation of the Ecocontract ULTRA All Timber 'top/side' and 'bottom' in a Timber frame.

In the following figures, the heat flux results are shown on the left, with the respective isothermal results shown on the right. The construction details are in the appendices.

In order to better represent the details, only relevant sections of the calculation model are shown.

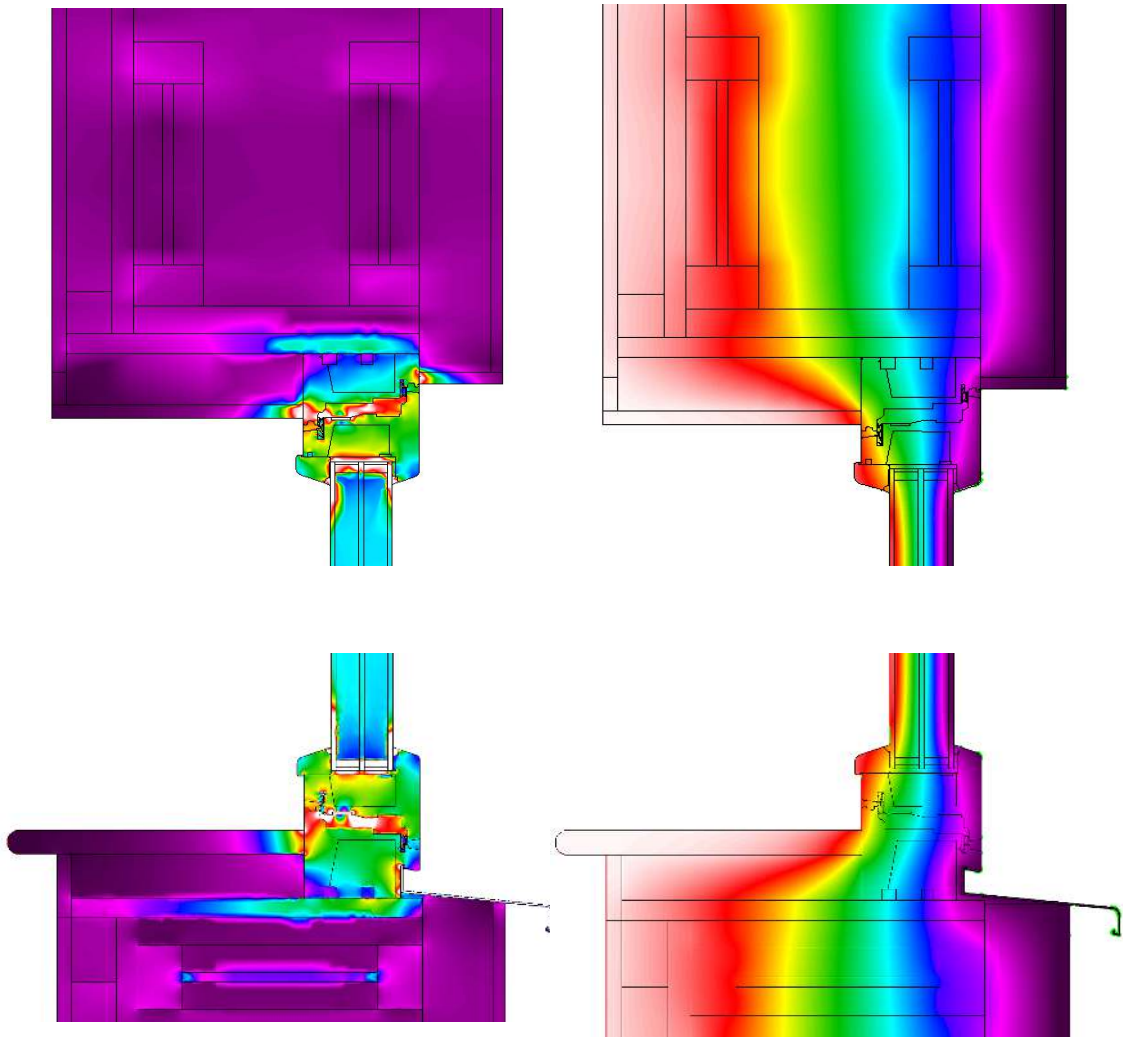


Figure 4: Installation 'bottom' and 'side/top' in a Timber frame with respective isothermal graphic

	U_{wall} [W/(m ² K)]	$\Psi_{\text{instal., bottom}}$ [W/(mK)]	$\Psi_{\text{instal., top}}$ [W/(mK)]	$\Psi_{\text{instal., side}}$ [W/(mK)]	$U_{W,\text{installed}}$ [W/(m ² K)]
	0.126	-0.002	-0.019	-0.003	0.86

7.3 Externally insulated wall

The following figure shows the installation of the Ecocontract ULTRA All Timber 'side/top' and 'bottom' in a Externally insulated wall.

In the following figures, the heat flux results are shown on the left, with the respective isothermal results shown on the right. The construction details are in the appendices.

In order to better represent the details, only relevant sections of the calculation model are shown.

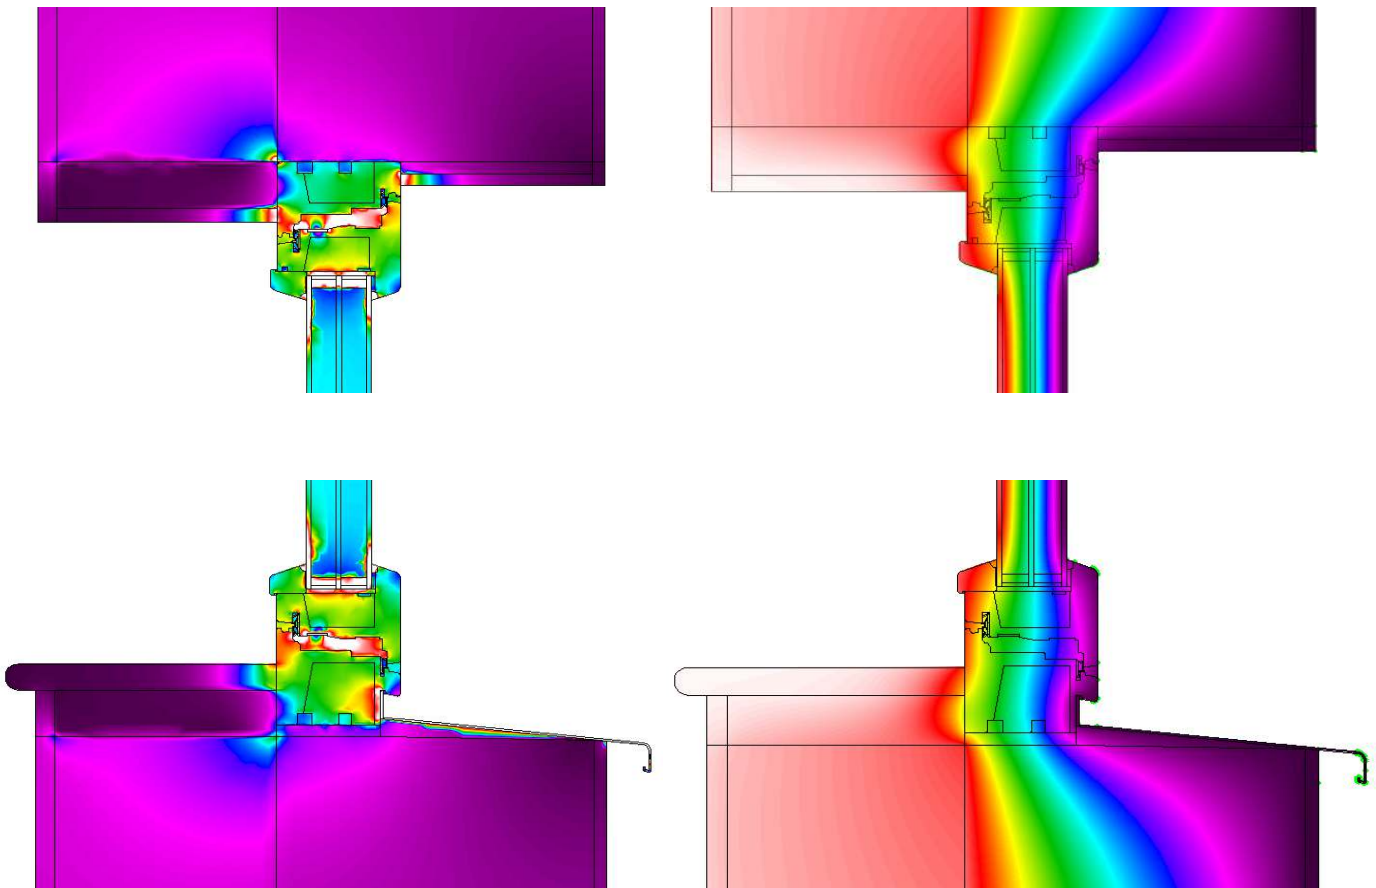


Figure 5: Installation 'bottom' and 'side/top' in a Externally insulated wall with respective isothermal graphic

	U wall [W/(m ² K)]	$\Psi_{\text{instal., bottom}}$ [W/(mK)]	$\Psi_{\text{instal., s./top}}$ [W/(mK)]	$U_{W,\text{installed}}$ [W/(m ² K)]
	0.14	0.019	0.005	0.90

8. Alternative glasses offered by manufacturer

In deriving the performance of windows, the convention is to install a standard quality of glazing with a centre U value of 0.7 W/(m²K) to enable a fair comparison of the frames.

However, for analysis in PHPP it is important to know the properties of the actual glass to be offered by the manufacturer. These obviously include the centre of glass U-value of the glazed unit, but also the g-value, which is the fraction of solar heat that passes through the glass at normal incidence.

These values commonly change if the glass is required to have security, safety, or obscured properties. Usually this is because as the glass thickness changes, the gas cavity also changes to maintain a fixed total sealed unit thickness. The g-value can also change with some obscured or laminated glass types.

The following list has been provided by the manufacturer to help choose the correct properties in PHPP. This glazing data is included in the PHPP data value in the next section, but here we also show the PHI glazing rating, which is expressed as:


$$U_{eg} = U_g - 1.6 \times g \quad \text{where 1.6 is a climate factor for cool temperate regions}$$

PHI scale:	Rating	U_{eq} W/(m ² K)
	D	≥ 0
	C	≥ -0.2 but < 0
	B	≥ -0.35 but < -0.2
	A	< -0.35

	g	Ug	
Standard_4-20-4-20-4 Guardian Climaguard Premium/Clear float/Guardian Climaguard Premium_Argon 90%	0.49	0.52	B
Safety_4-20-6.4-20-4 AGC Top N+T toughened/Clear laminated/AGC Top N+T toughened_Argon 90%	0.49	0.52	B
High g_4-20-4-20-4 Planitherm Lux/Clear float/Planitherm Lux_Argon 90%	0.63	0.61	A


10. Appendix: Construction drawings - (not to scale)

Ecocontract ULTRA All Timber: Frame section - Head/jamb and Cill

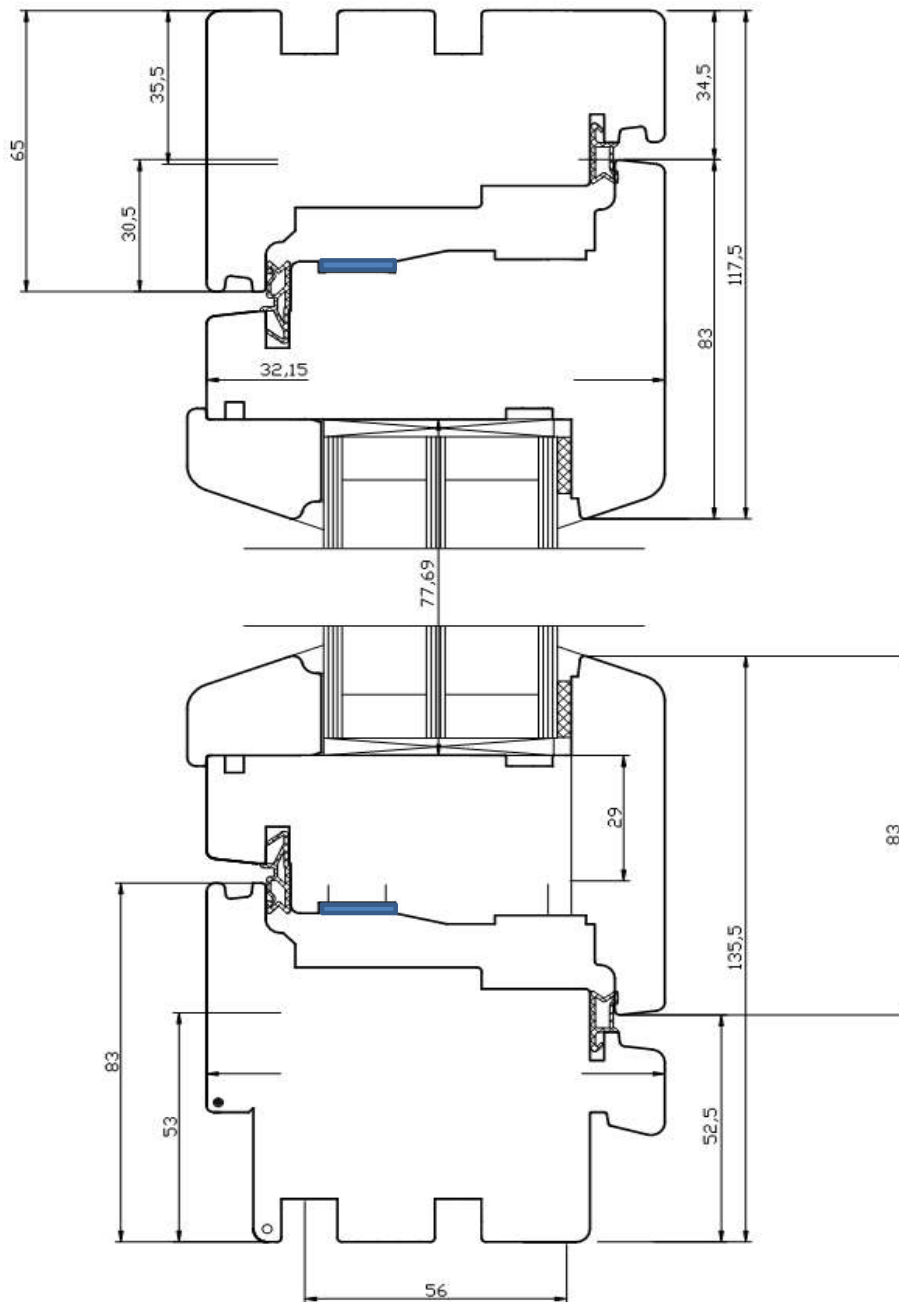



52mm glazing unit

Ecocontract ULTRA All Timber: Section of Window Head and Cill (not to scale)

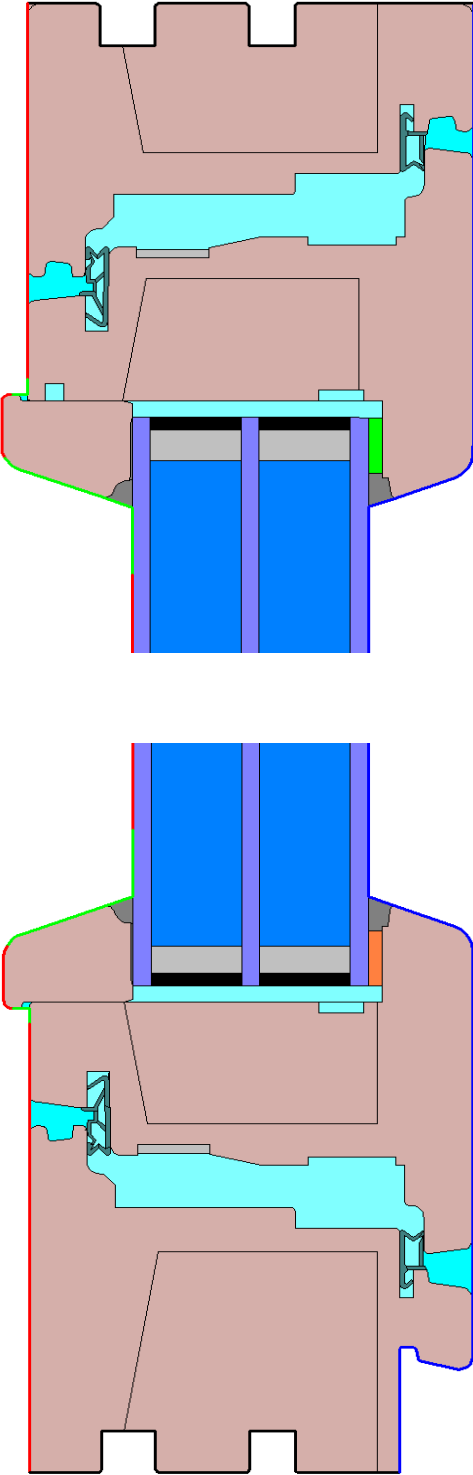


See page 7 for colour key

Ecocontract ULTRA All Timber: Installation section for Cavity wall (not to scale)

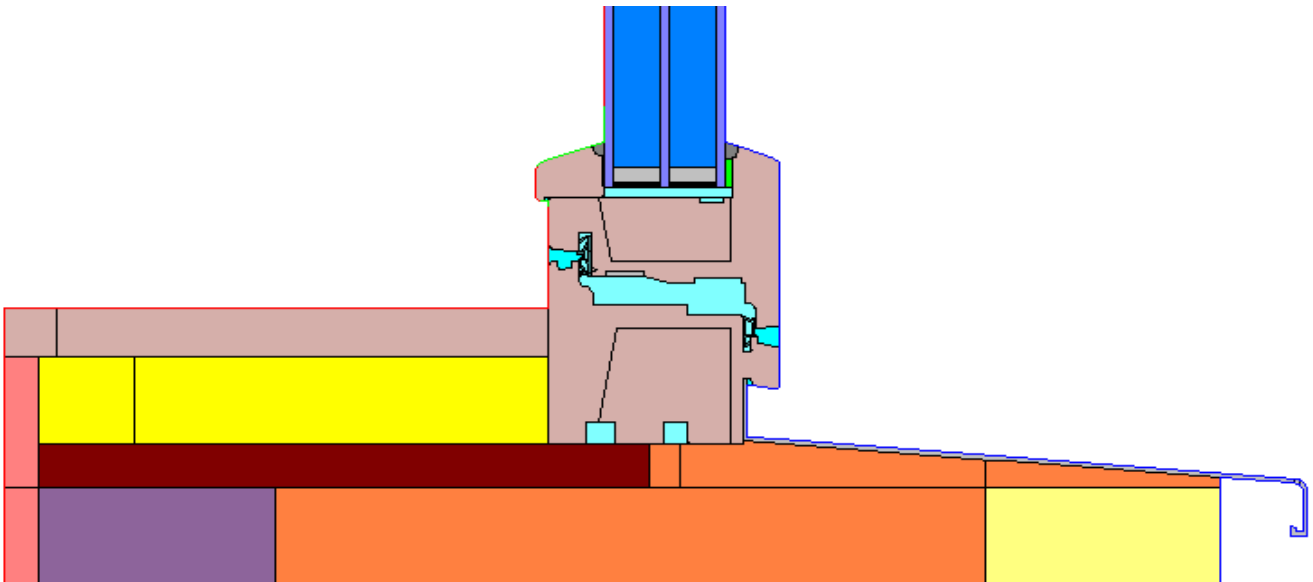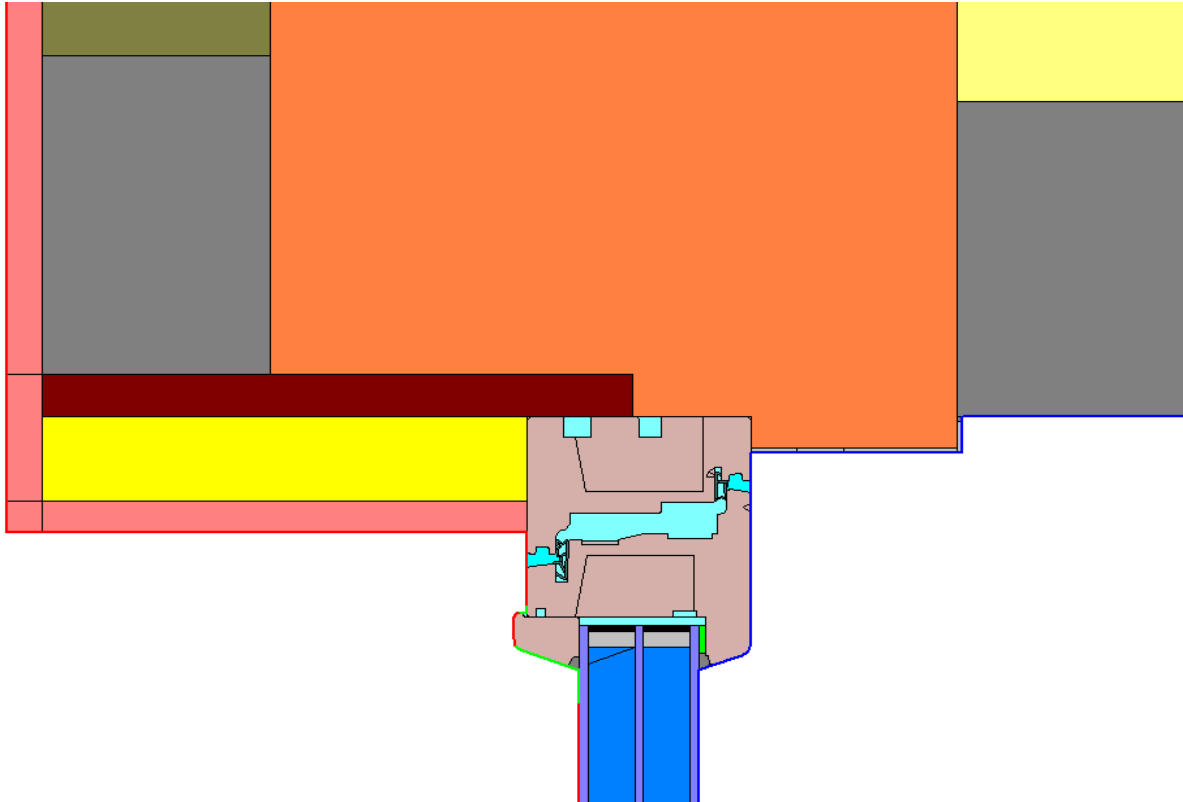



Cavity wall has a U-value of 0.118 W/(m²K)

Ecocontract ULTRA All Timber: Installation section for Timber frame (not to scale)

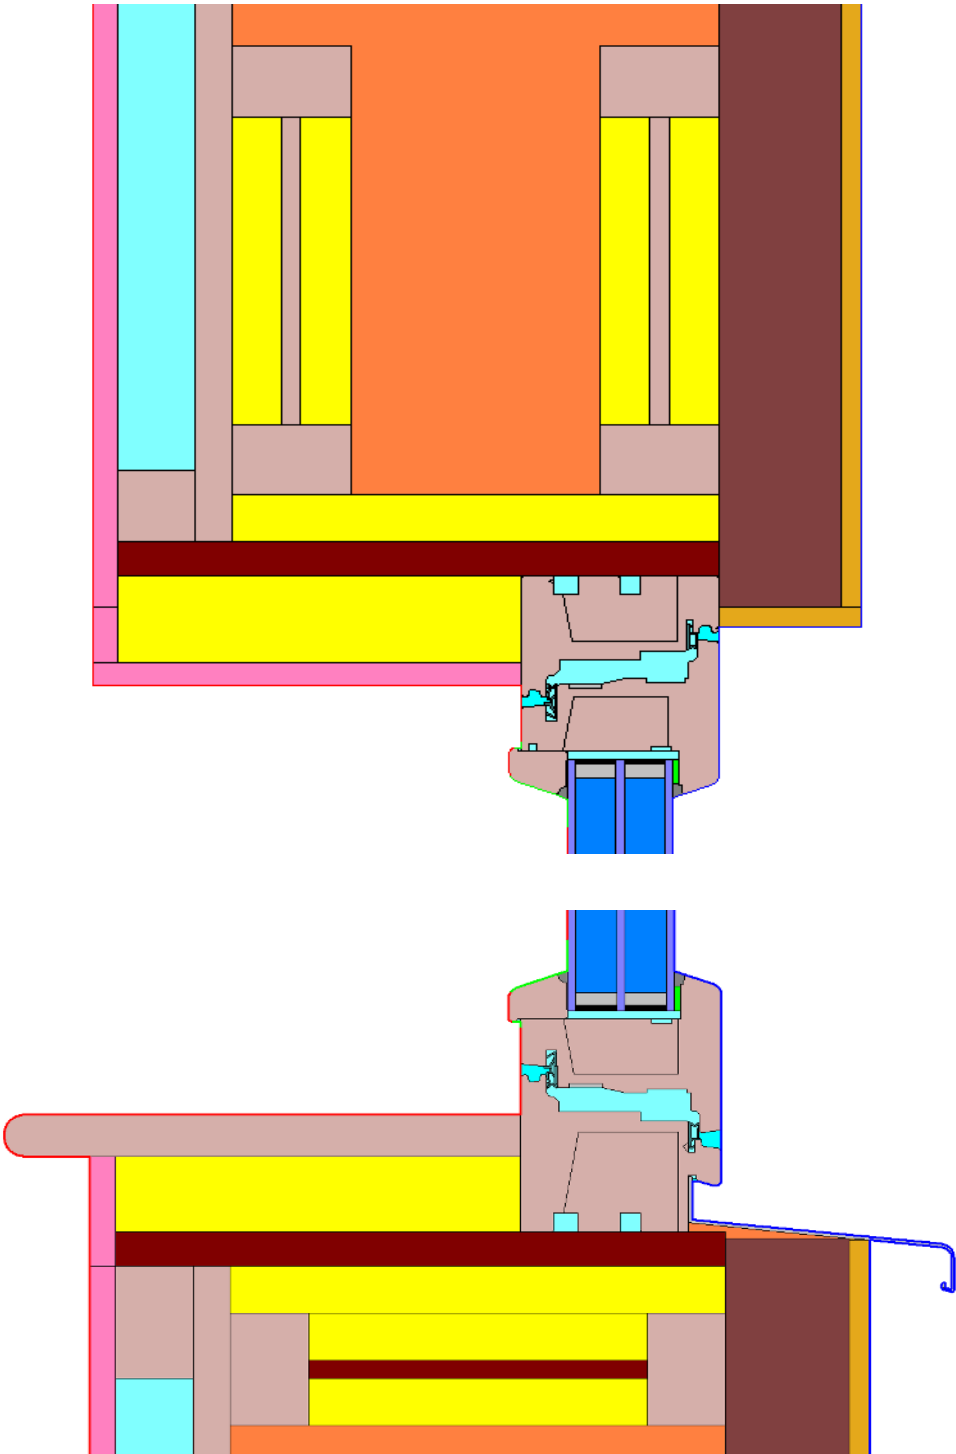

Timber frame has a U-value of 0.126 W/(m²K)
See page 7 for colour key

Ecocontract ULTRA All Timber: Installation section for Externally insulated wall (not to scale)

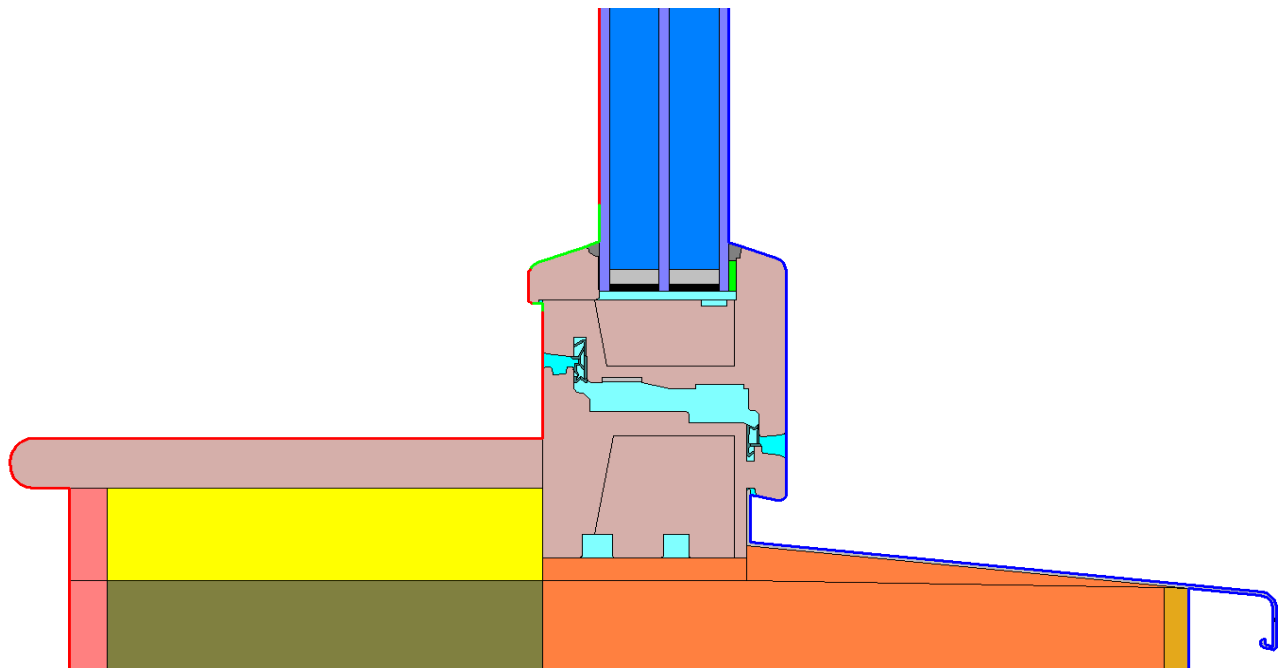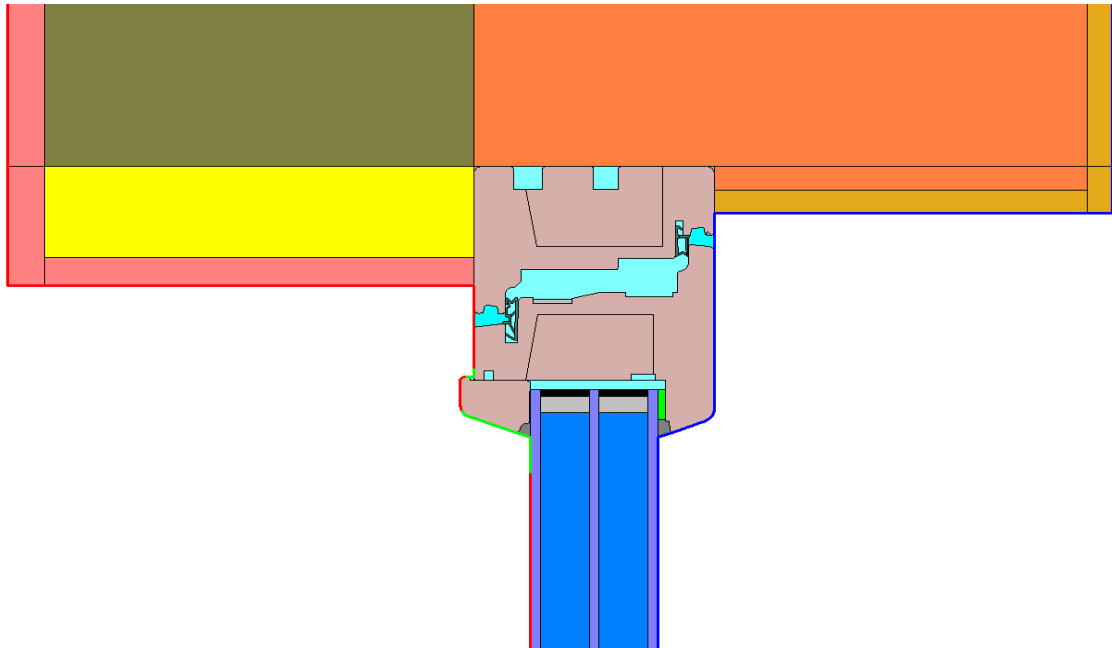

Externally insulated wall has a U-value of 0.139 W/(m²K)